


MULTIPLES OF PICK-UP SETTING

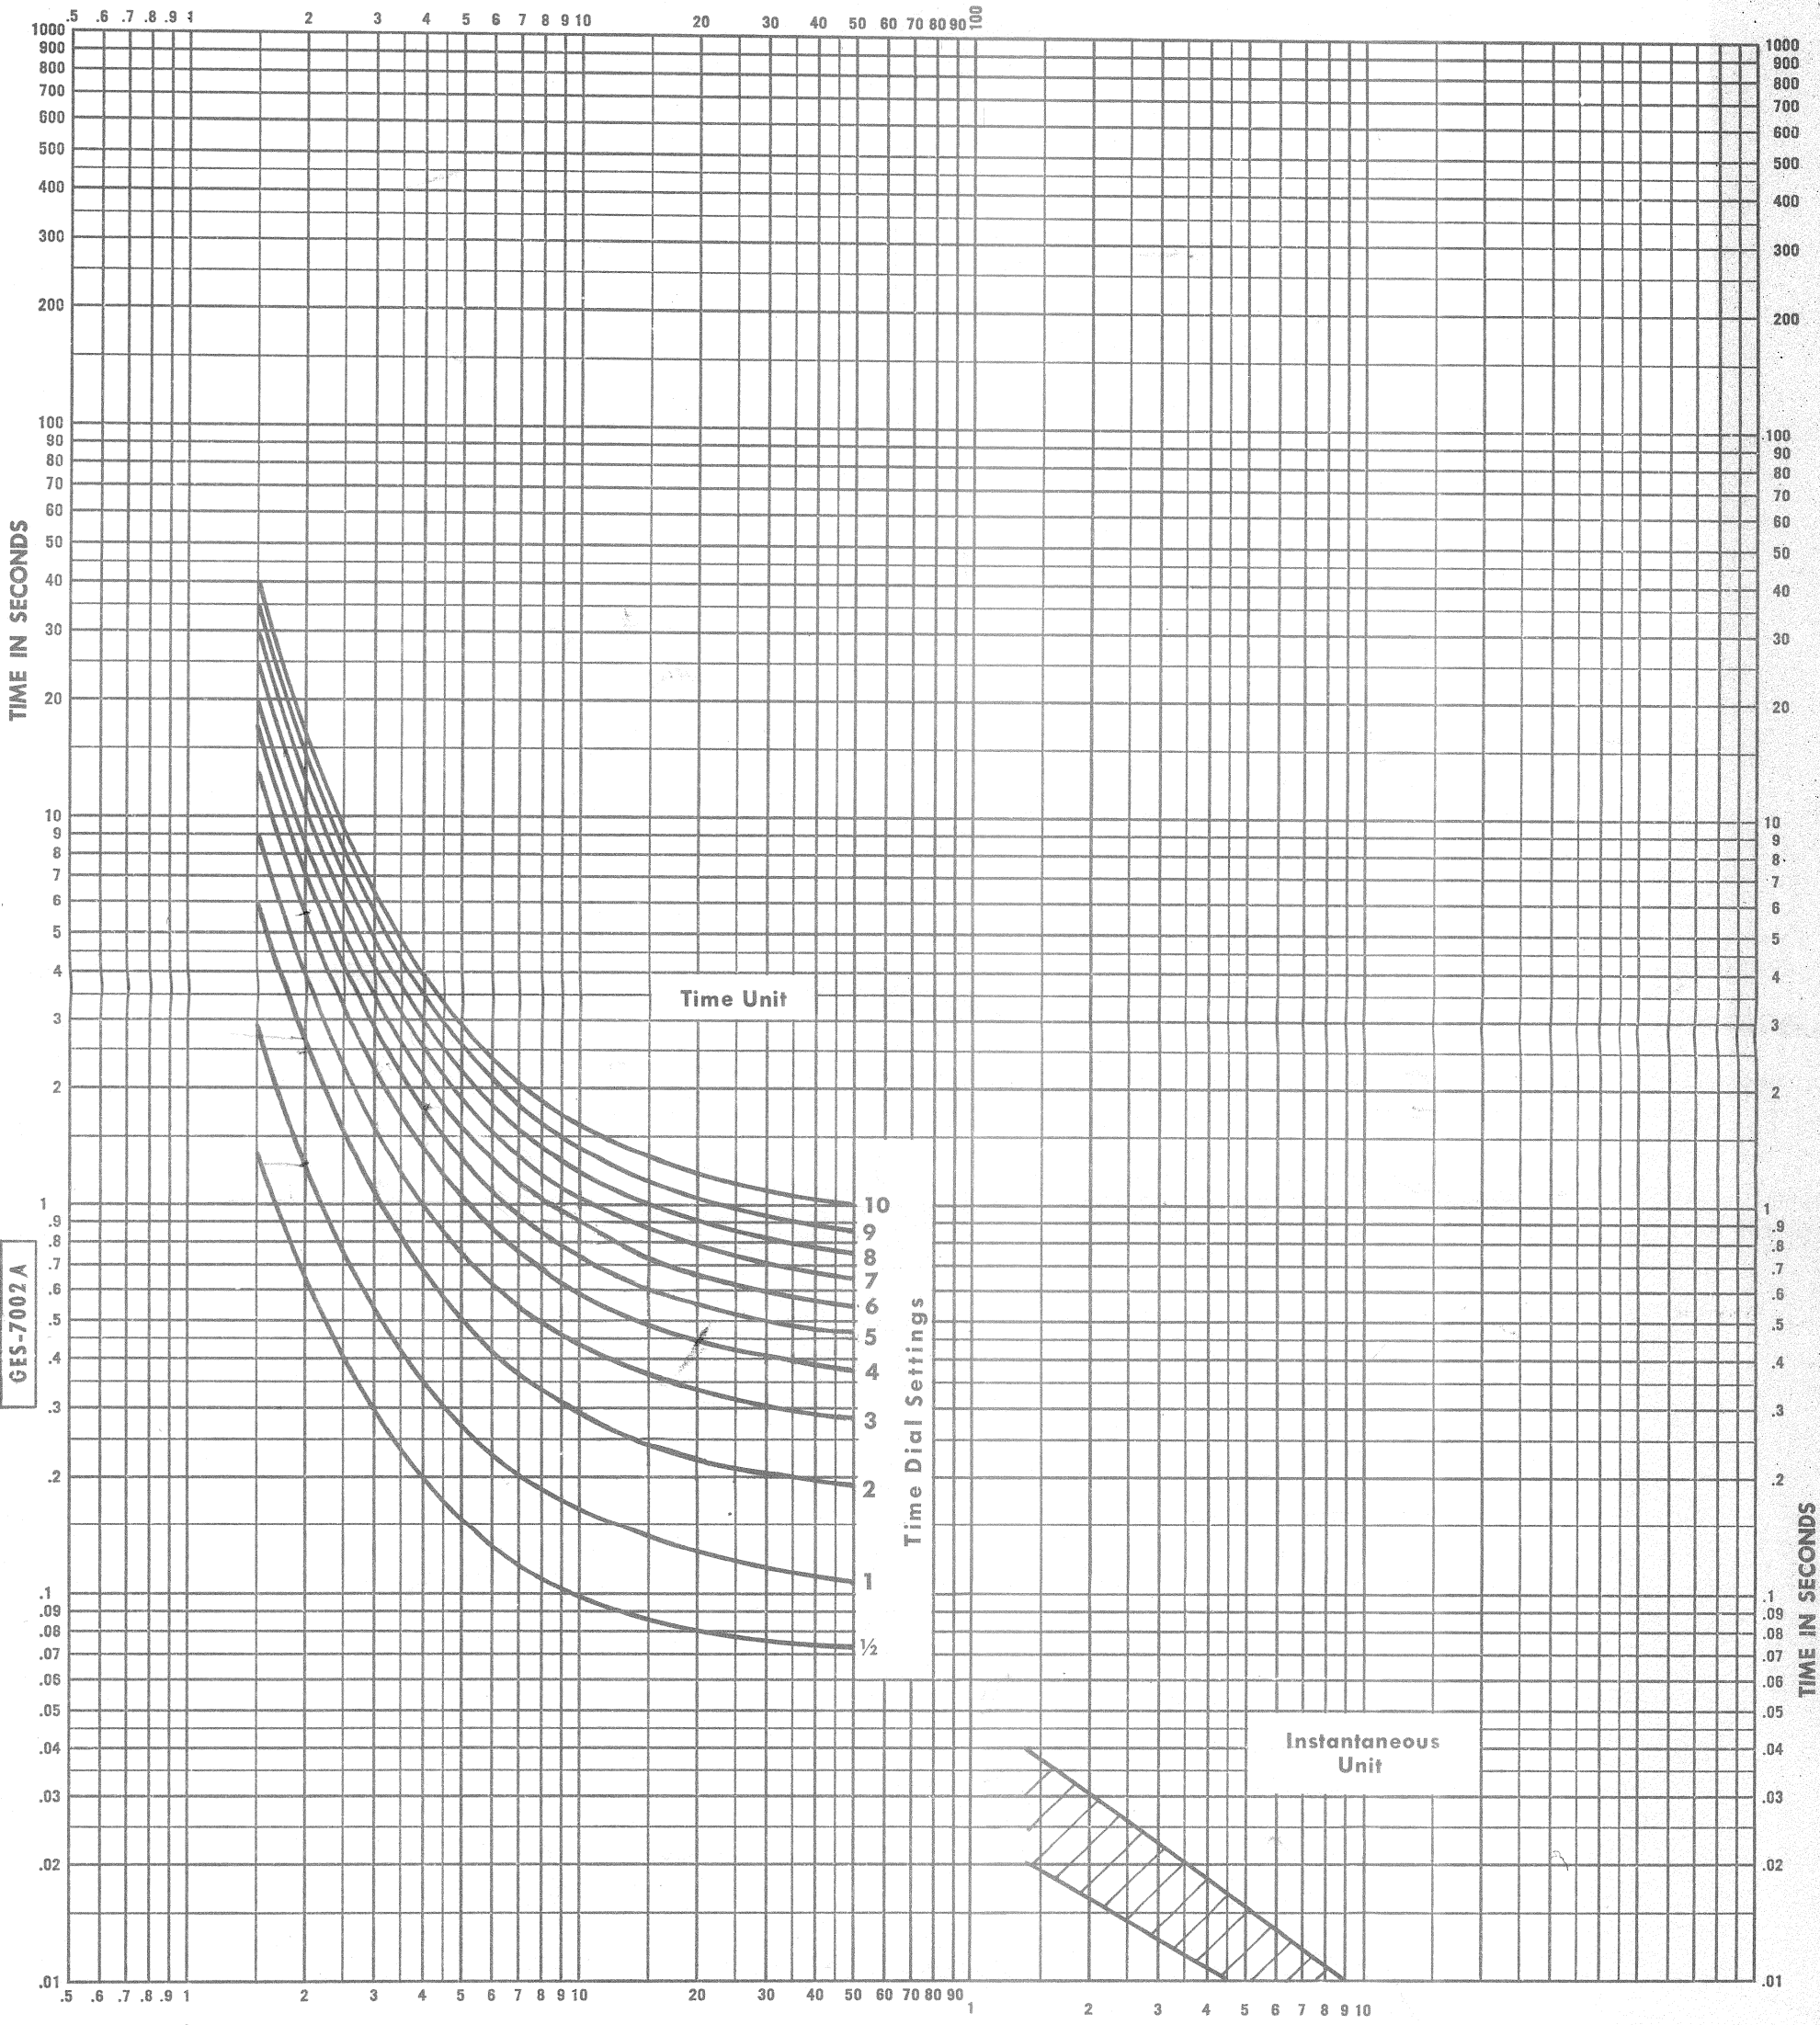

MULTIPLES OF PICK-UP SETTING

<b>GENERAL ELECTRIC</b>		<b>TIME OVERCURRENT RELAY IAC 53 RELAY</b>		<b>GES-7002 A</b>	
<b>Ratings (Amperes)</b>		<b>Very Inverse Standard Time Time-Current Curves</b>		<b>Settings</b>	
Time Unit	Instantaneous Unit	( Other relays with duplicate time delay characteristics ) GYC53, IAC54-80-81, IBC53-54, IBCG53-54, IBCV53-54, JBC53-54, JBCG53-54, JBCV53-54		Time Unit (Taps)	Inst. Unit
0.5-2 1.5-6 4.0-16	2-8 4-16 10-40 20-80 40-160			0.5, 0.6, 0.8, 1.0, 1.2, 1.5, 2.0 1.5, 2.0, 2.5, 3.0, 4.0, 5.0, 6.0 4.0, 5.0, 6.0, 8.0, 10.0, 12.0, 16.0 4.0, 5.0, 6.0, 7.0, 8.0, 10.0, 12.0, 16.0	Continuously Adjustable